


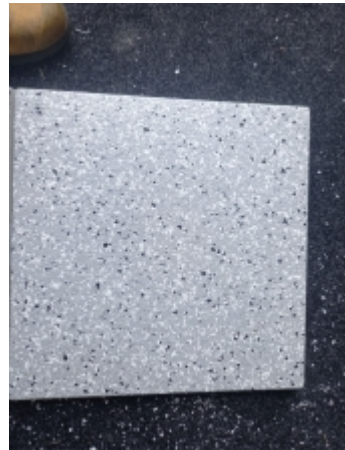
**Epoxy Flooring Co - Speckled Grey Full Flake Epoxy Sample Applied to Pavers
50x50cm - Wet Sliptest MG030322-8**

03 Mar 2022

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	03 Mar 2022
Test Report Number:	MG030322-8
Client Name & Address:	Epoxy Flooring Co - PO Box 39 Noosa Heads Qld 4567
Test Site / Surface Tested :	Speckled Grey, Full Flake, Epoxy, Sample Pavers, 50x50cm, Fine textured
Sample Information :	Samples and Test Information Supplied by Client
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Any Variations to Standards	Variation of Standards only 1 Sample Available for testing
Testing Officer / Approved Signatory:	Michael Genero
Pendulum in use - Calibration Date :	#SK2072 - Wessex Portable Skid Tester (C : 07.05.21)
Signature of Approved Signatory :	

Test Results :

Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	SCV :	Surface Picture
Sample 1 - 0°	32	31	30	30	30	30	N/A	
Sample 1 - 45°	31	30	29	28	28	28	N/A	
Sample 1 - 90°	30	30	29	29	29	29	N/A	

Variation to Standard Mean BPN Slip Resistance Value (SRV) 29

CLASSIFICATION using Slider 96 (4S Slider) P2 = 25 - 34

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A - Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results to not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

Page 1 of 1 - END OF REPORT